


591.119  
DRAWING NUMBER  
CANTOR Fitzgerald  
E-2 #1 7-11-85

DRAWING NUMBER

DRAWING NUMBER

DRAWING NUMBER

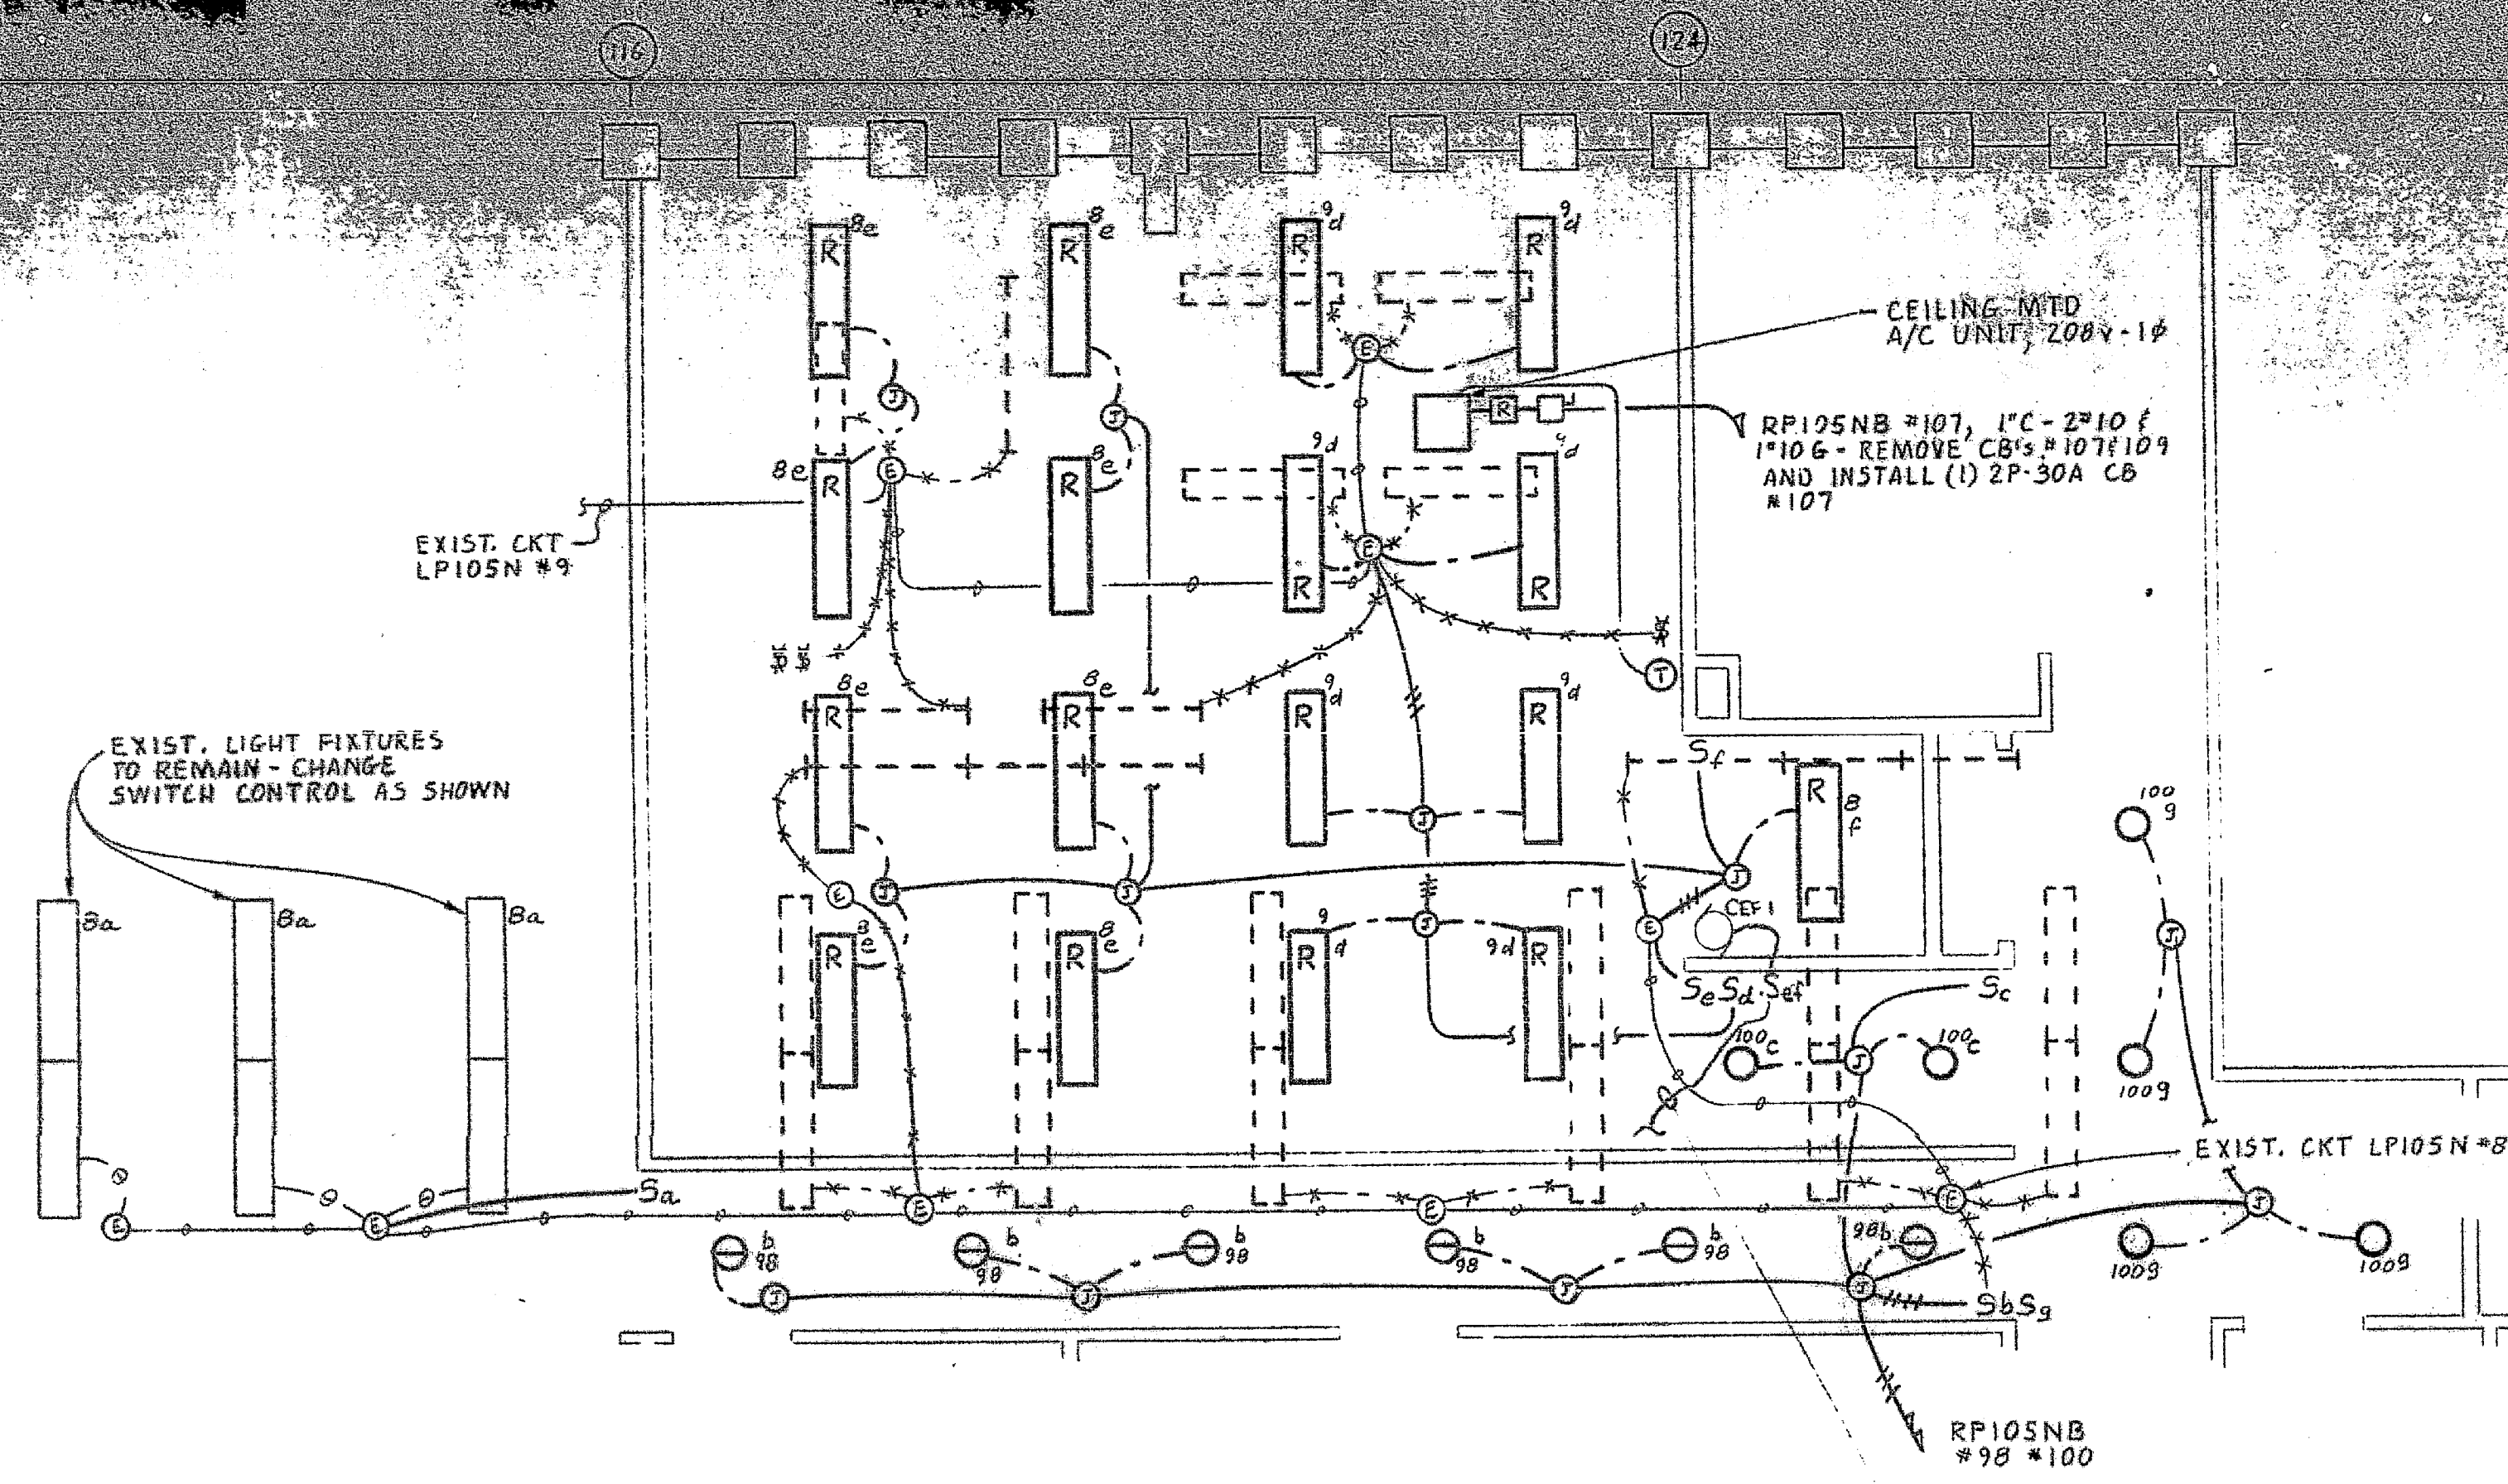


LEGEND

- EXISTING STRIP LIGHT TO BE REMOVED
- EXISTING 1x4' FLUORESCENT FIXTURE TO REMAIN
- EXISTING 1x4' FLUORESCENT FIXTURE TO BE RELOCATED
- RELOCATED 1x4' FLUORESCENT FIXTURE\*
- RECESSED WALL WASHER - 100W
- RECESSED DOWN LIGHT - 100W
- EXISTING JUNCTION BOX TO REMAIN
- JUNCTION BOX
- EXISTING SWITCH TO BE REMOVED
- S SINGLE POLE TOGGLE SWITCH 20A-277V. WALL MTD 50" AFF HUBBELL #H21-GRAY, OR 15A-125V #H01-GRAY. LETTER DENOTES CONTROL.
- EXISTING CONDUIT & WIRING TO REMAIN
- REMOVE EXISTING CONDUIT & WIRING
- RIGID STEEL CONDUIT (U.L. STD #6) RUN CONCEALED
- EXISTING FLEXIBLE CONDUIT & CABLE CONNECTION TO REMAIN
- REMOVE EXISTING FLEXIBLE CONDUIT & CABLE CONNECTION
- FLEXIBLE CONDUIT & CABLE CONNECTION (U.L. STD #14)
- HOMERUN TO PANEL INDICATED. MINIMUM SIZE 1" CDT.
- 2"14 TEFLON SMOKE DETECTION WIRING
- F FLEXIBLE CONDUIT - MINIMUM SIZE 3/4"
- UF SMOKE DETECTOR - "UF" DENOTES UNDERFLOOR MOUNTED
- T THERMOSTAT
- K KEY OPERATED SWITCH WALL MOUNTED 50" AFF, 15A-125V HUBBELL #H01-L
- R EXISTING RECEPTACLE TO REMAIN
- = R REMOVE EXISTING RECEPTACLE
- W WALL MOUNTED RECEPTACLE 15A-125V HUBBELL #5262
- D DUPLEX RECEPTACLE MOUNTED ON WIREMOLD HUBBELL #5262
- K KEY SWITCH CONTROLLED DUPLEX RECEPTACLE MOUNTED ON WIREMOLD HUBBELL #5262

LIGHTING PLAN  
SCALE: 1/4" = 1'-0"


LEGEND (CONT'D)

- KEY-SWITCH CONTROLLED DUPLEX RECEPTACLE - 15A-125V HUBBELL #5262
- OPENING IN RAISED FLOOR FOR WIRING TO TRADING DESK
- FLOOR MOUNTED DUPLEX RECEPTACLE SPLIT-WIRED FOR (2) 20A-125V CIRCUITS HUBBELL #5362. CONNECT TO FLOOR CELL WITH CDT & AFTERSET FITTING (SEE NOTE #1 FOR AFTERSET FITTING)
- FLOOR MTD COMBINATION TEL/DUPLEX RECEPTACLE TO BE REMOVED. REMOVE AFTERSET FITTING AND FLOOR SLAB.
- PLUG-MOLD, SIZE AS INDICATED, LENGTH AS INDICATED, WITH SINGLE RECEPTS 15A-125V SPACED AS INDICATED.
- WALL MOUNTED TELEPHONE OUTLET - CONNECT TO FLOOR CELL WITH CONDUIT AND AFTERSET FITTING (SEE NOTE #1 FOR AFTERSET FITTING)
- TELEPHONE JACK MOUNTED TO UNDERSIDE OF TRADING DESK - PROVIDED & INSTALLED BY I.P.C.
- 40 LINE TELEPHONE TURRET BUILT INTO TRADING DESK I.P.C. MODULAR SERIES II
- CEF CEILING EXHAUST FAN
- Sce WALL SWITCH W/ PLUG LT FOR CEF

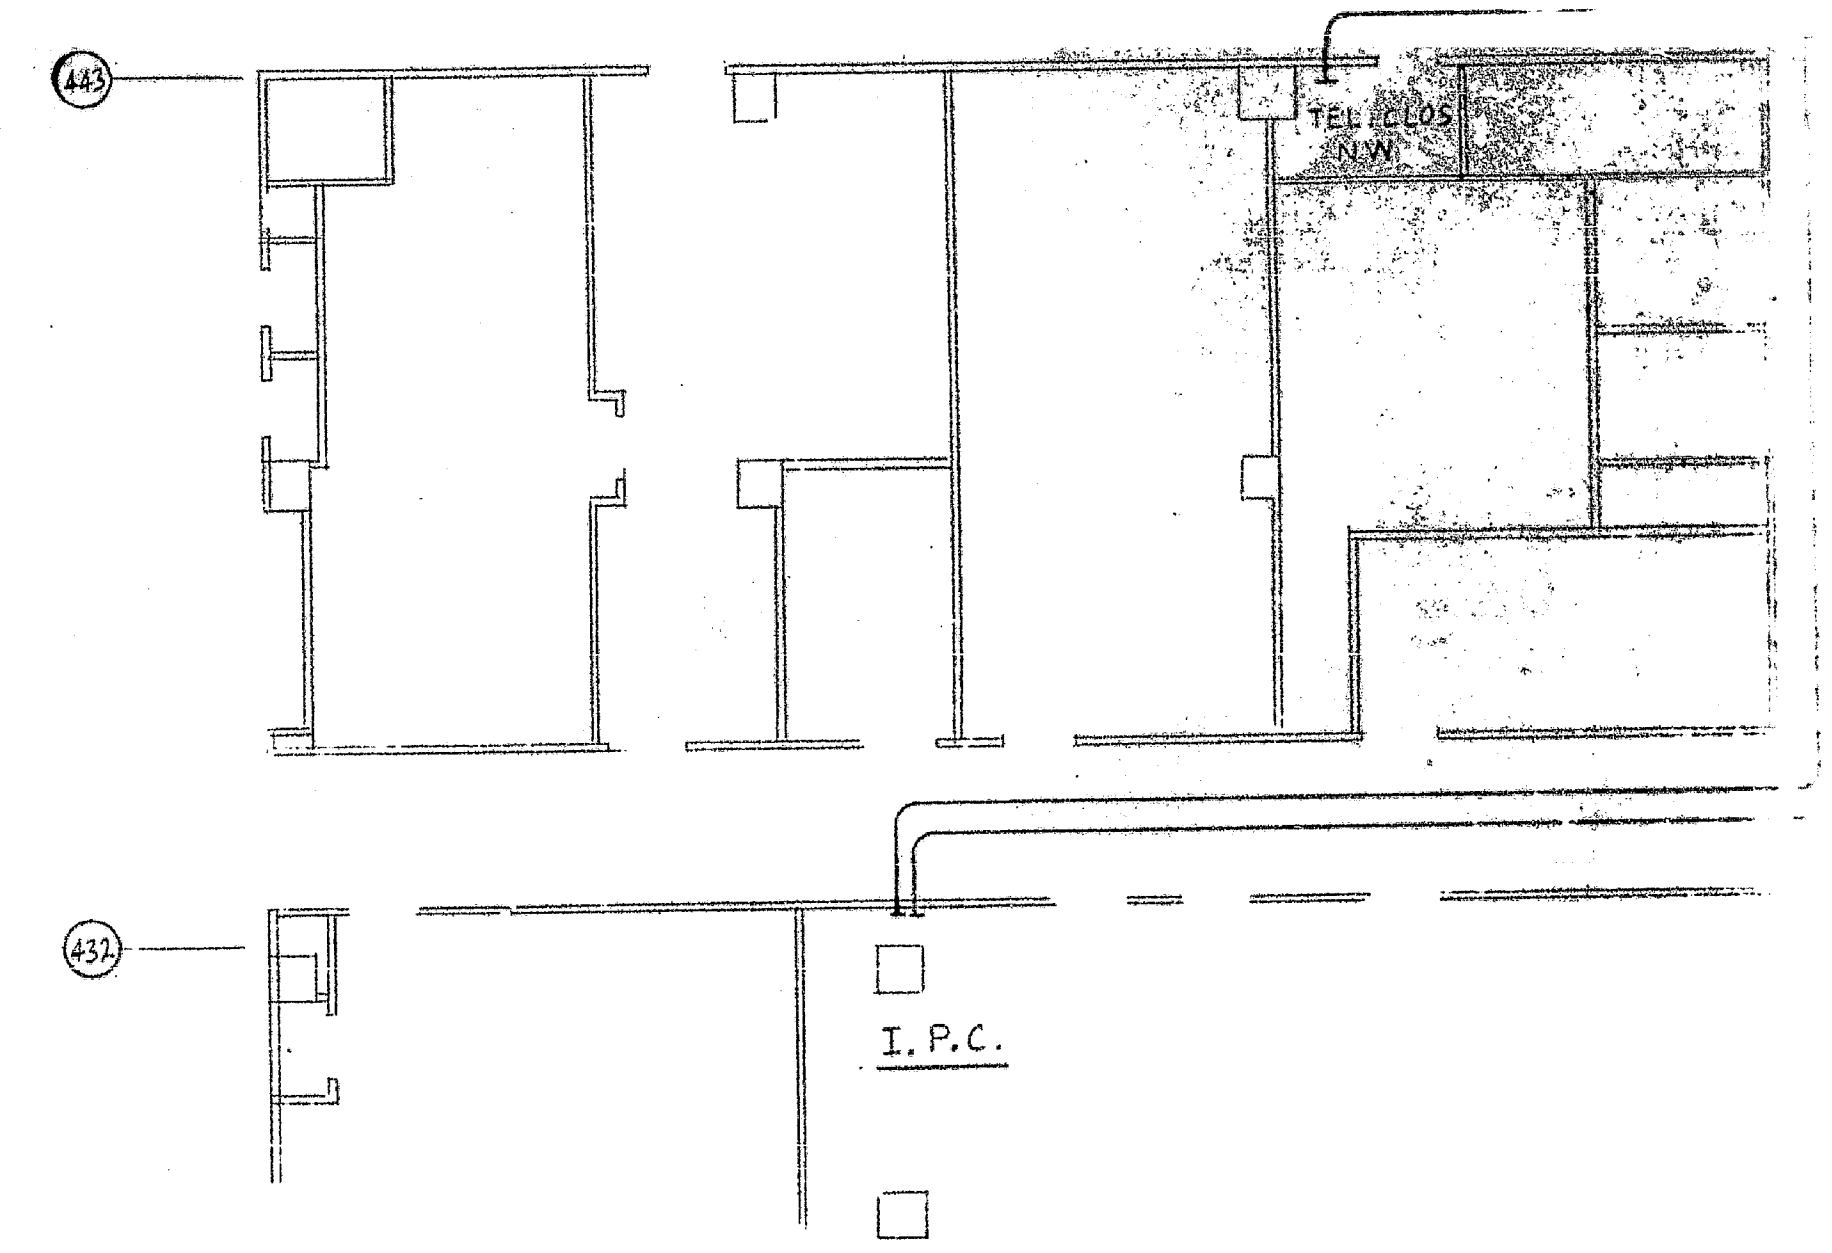

PLAN - TELEPHONE CONDUIT RUNS  
SCALE: 1/8" = 1'-0"

TCA/TAA NO. 3104  
CONTRACT NO. 591.119  
DATE APPROVED 1/28/85

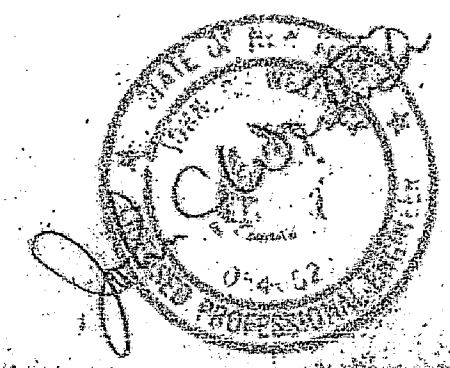

REV	1-10-85	AS PER P.E. COMMENTS
NEW CORPORATE BOND TRADING CANTOR FITZGERALD SECURITIES CO. ONE WORLD TRADE CENTER - 100R 105 NEW YORK, N.Y. 10048		
LIGHTING PLAN		
JOHN C. WESTRICK & ASSOCIATES CONSULTING ENGINEERS 2110 MAPLE AVENUE SOUTH PLAINFIELD, N.J. 07080		
DATE	1-28-85	BY
CHIEF ENGINEER		